


530 Duff Dr. Initial Test (Pool Leaking)

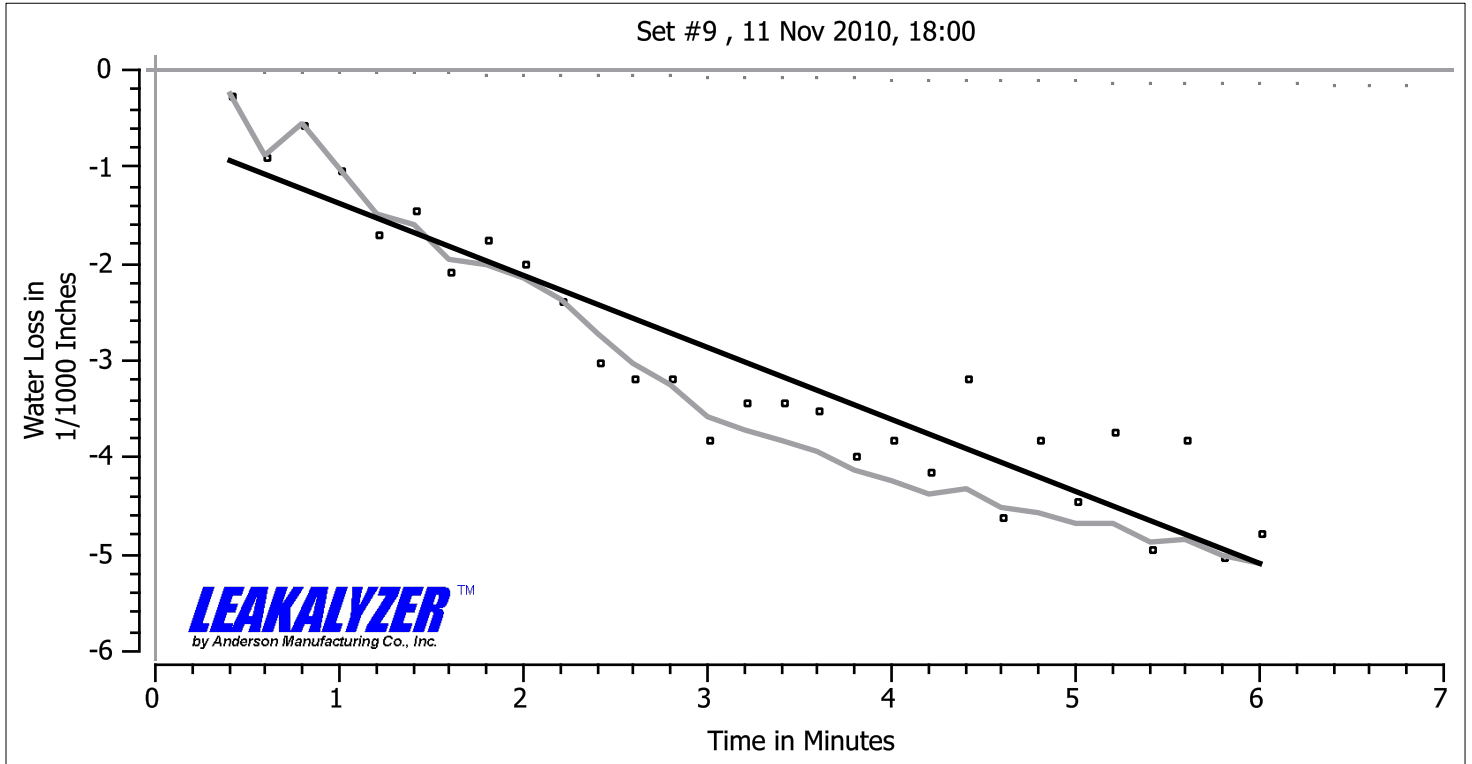

All Data				
	Estimated Rates ($R^2 = 0.872$)			
	in/hr	in/day	gal/hr	gal/day
Total Water Loss	0.045	1.07	9.2	220.3
Estimated Evaporation	0.001	0.03	0.3	7.2
Estimated Leak	0.043	1.04	8.9	213.1